
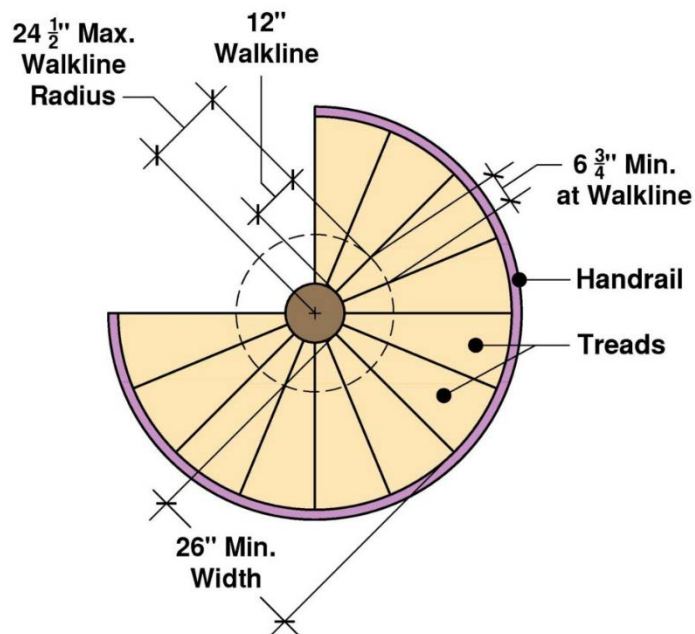


Residential Spiral Stairways Requirements

2020 MN Residential Code Section [R311.7.10.1](#)

1. The clear width at and below the handrails shall be not less than **26"**, and the walkline radius shall be not more than **24 1/2"**.
2. Each tread requires a minimum **6 3/4"** depth at the walkline **12"** out from the inside turn.
3. Treads shall be identical with a maximum **9 1/2"** rise, and slope not more than **1/4"**.
4. Tread depth and riser height shall not exceed the smallest by more than **3/8"**.
5. Headroom shall be not less than **6' - 6"**.

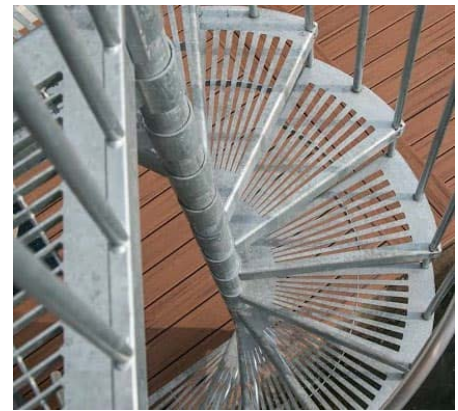

Accuracy – Efficiency – Uniformity